

NOTES:


1. TANK VOLUME TO BE DETERMINED BY GRU UPON APPLICATION BY OWNER, STRUCTURAL DESIGN SHALL BE THE RESPONSIBILITY OF THE TANK MANUFACTURER.
2. ONLY KITCHEN WASTE SHALL BE DISCHARGED INTO THE GREASE TRAP. ALL DOMESTIC WASTE (i.e. RESTROOMS) SHALL BE CONNECTED DOWNSTREAM OF THE GREASE TRAP.
3. MANHOLES WHICH ARE NOT INSTALLED UNDER PAVEMENT SHALL HAVE A RIM ELEVATION AT LEAST 6" ABOVE FINISHED GRADE, AND A 10:1 SLOPE TO FINISHED GRADE.
4. GREASE TRAP ASSEMBLY TO BE H-20 TRAFFIC LOAD RATED - INCLUDING TANK, TANK LID, CHIMNEYS AND MANHOLE RING & COVER.
5. NO CAPPED TEES.
6. SINGLE TANK SIZE MAXIMUM CAPACITY IS 2,000 GALLONS. MINIMUM CAPACITY SIZE IS 1,000 GALLONS
7. TANK MUST BE 1 PIECE, UNSEALED.
8. IF TANK LOCATION IS IN GREEN SPACE, 12" CONCRETE COLLAR REQUIRED. IF TANK LOCATION IS IN ASPHALT, FINAL GRADE REQUIRED.

Revision Date:  
10/04/2024



Gainesville Regional Utilities  
Wastewater Construction Details

GREASE TRAP

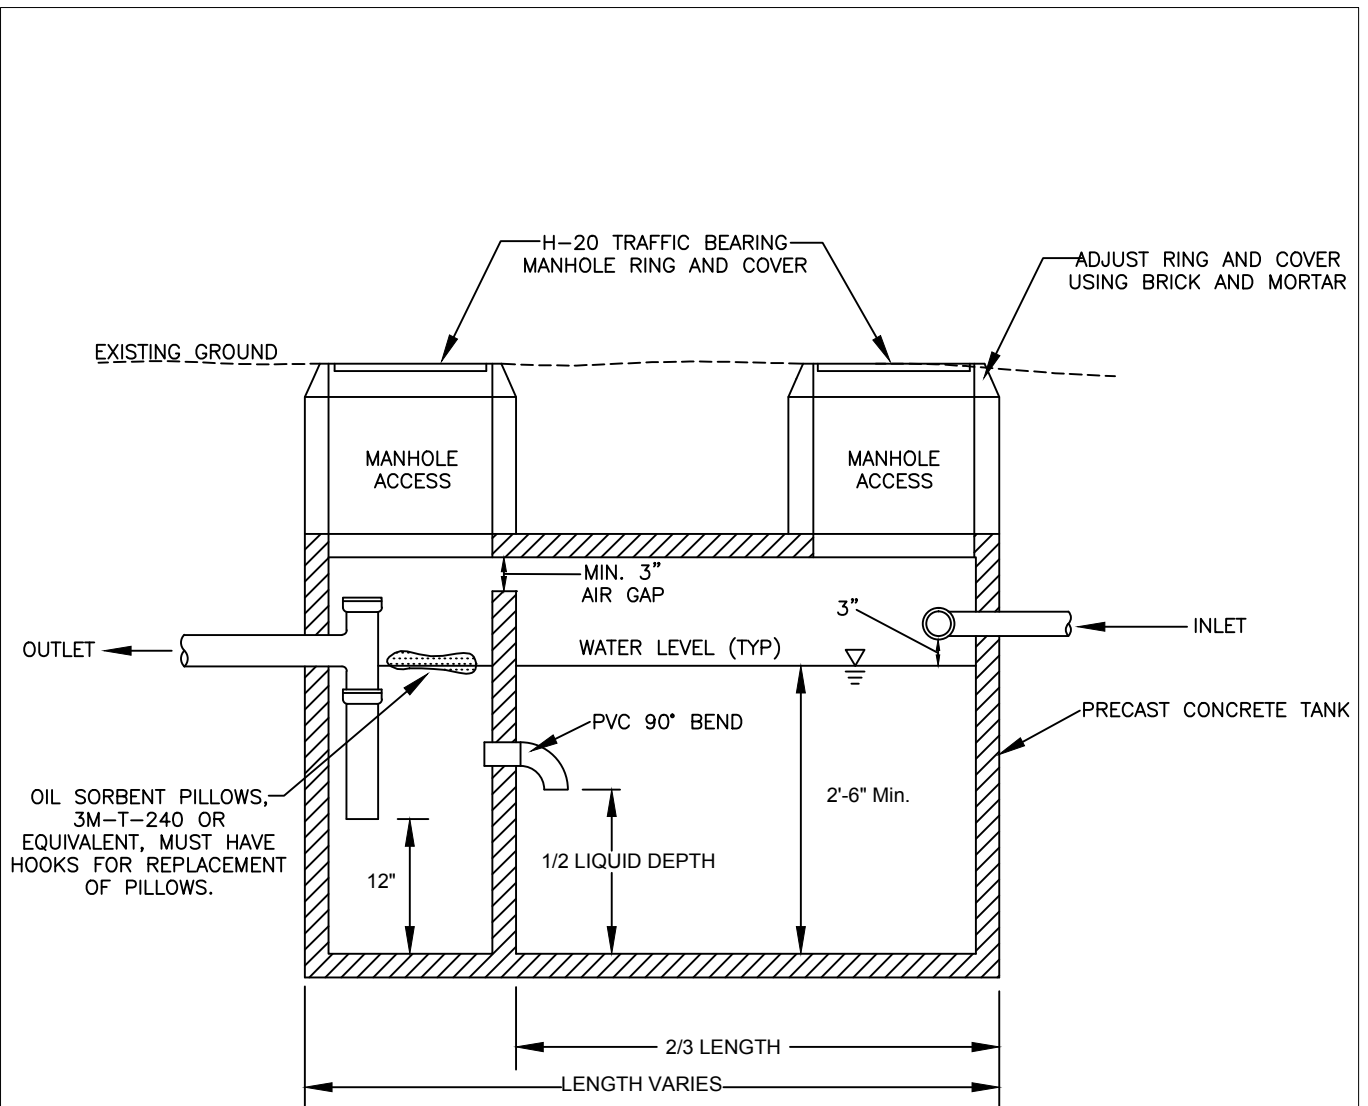

**NOTES:**

1. VOLUME TO BE DETERMINED BY GRU UPON APPLICATION BY OWNER, STRUCTURAL DESIGN SHALL BE THE RESPONSIBILITY OF THE TANK MANUFACTURER.

Revision Date:  
8/22/2016



Gainesville Regional Utilities  
Wastewater Construction Details

OIL AND SAND INTERCEPTOR